

THIS DOCUMENT IS THE EXCLUSIVE PROPERTY OF INLINE FILLING SYSTEMS AND MAY NOT BE USED OR REPRODUCED, NOR ITS CONTENT OR PART THERE OF BE DISCUSSED TO OTHER BY ANY PERSON OR COMPANY WITHOUT THE WRITTEN CONSENT FROM INLINE FILLING SYSTEMS

REVISION DESCRIPTION	DATE	INIT
----------------------	------	------

**FTG 12 TO 16 BASE FRAME CORR RESIST**  
 W/ FTG 12 TO 16 FUME HOOD CORR RESIST  
 W/ FTG 12 TO 16 GUARDING CORR RESIST  
 W/ FTG16 CONTROLS CORR RESIST  
 W/ FTG16 TANK CORR RESIST  
 W/ FTG FLUID PATH PVC CHEM (x16)  
 W/ FTG NOZZLE KYNAR 1\_2 (x16)  
 W/ F STARWHEEL INDEXER CORR RESISTANT  
 W/ CONVD7 POLY 15 FT  
 Utilities:  
 Electrical: 120 VAC @ 10A  
 Air: 80 PSI @ 20 CFM

**CAPPER NT LH CORR RESISTANT**  
 W/ BOTTLE SPACER CORR RES  
 W/ CAPSORT CENTRIFUGAL 26 INCH LH  
 W/ CAPPER BULK FEEDER  
 W/ CONVD7 POLY 15  
 Utilities:  
 Electrical: 120 VAC @ 20A  
 Air: 80 PSI @ 14 CFM

**CONVD7 POLY 15 FT**  
 Utilities:  
 Electrical: 120 VAC / 10 AMPS


**CONVD7 POLY FLEX**  
 W/ CONVU7 POLY 15 (2 EA)  
 W / CONVU7 FLEX TURN  
 Utilities:  
 Electrical: 120 VAC / 10 AMP

**CONVD7 POLY FLEX**  
 W/ CONVU7 POLY  
 Utilities:  
 Electrical: 120 VAC / 10 AMPS

**AUTOMATIC DE - PUCK STATION**  
 W/ 140 PUCKS FOR 24 OZ ANGLE NECK  
 Utilities:  
 Electrical: 120VAC / 10 AMPS

**INDUCTION SEAL SS100**  
 Utility requirements:  
 Electrical: 230 VAC/ 7.5 AMPS

**CONVD7 POLY FLEX**  
 W/ CONVU7 POLY FLEX TURN  
 Utilities:  
 Electrical: 120 VAC / 10 AMPS

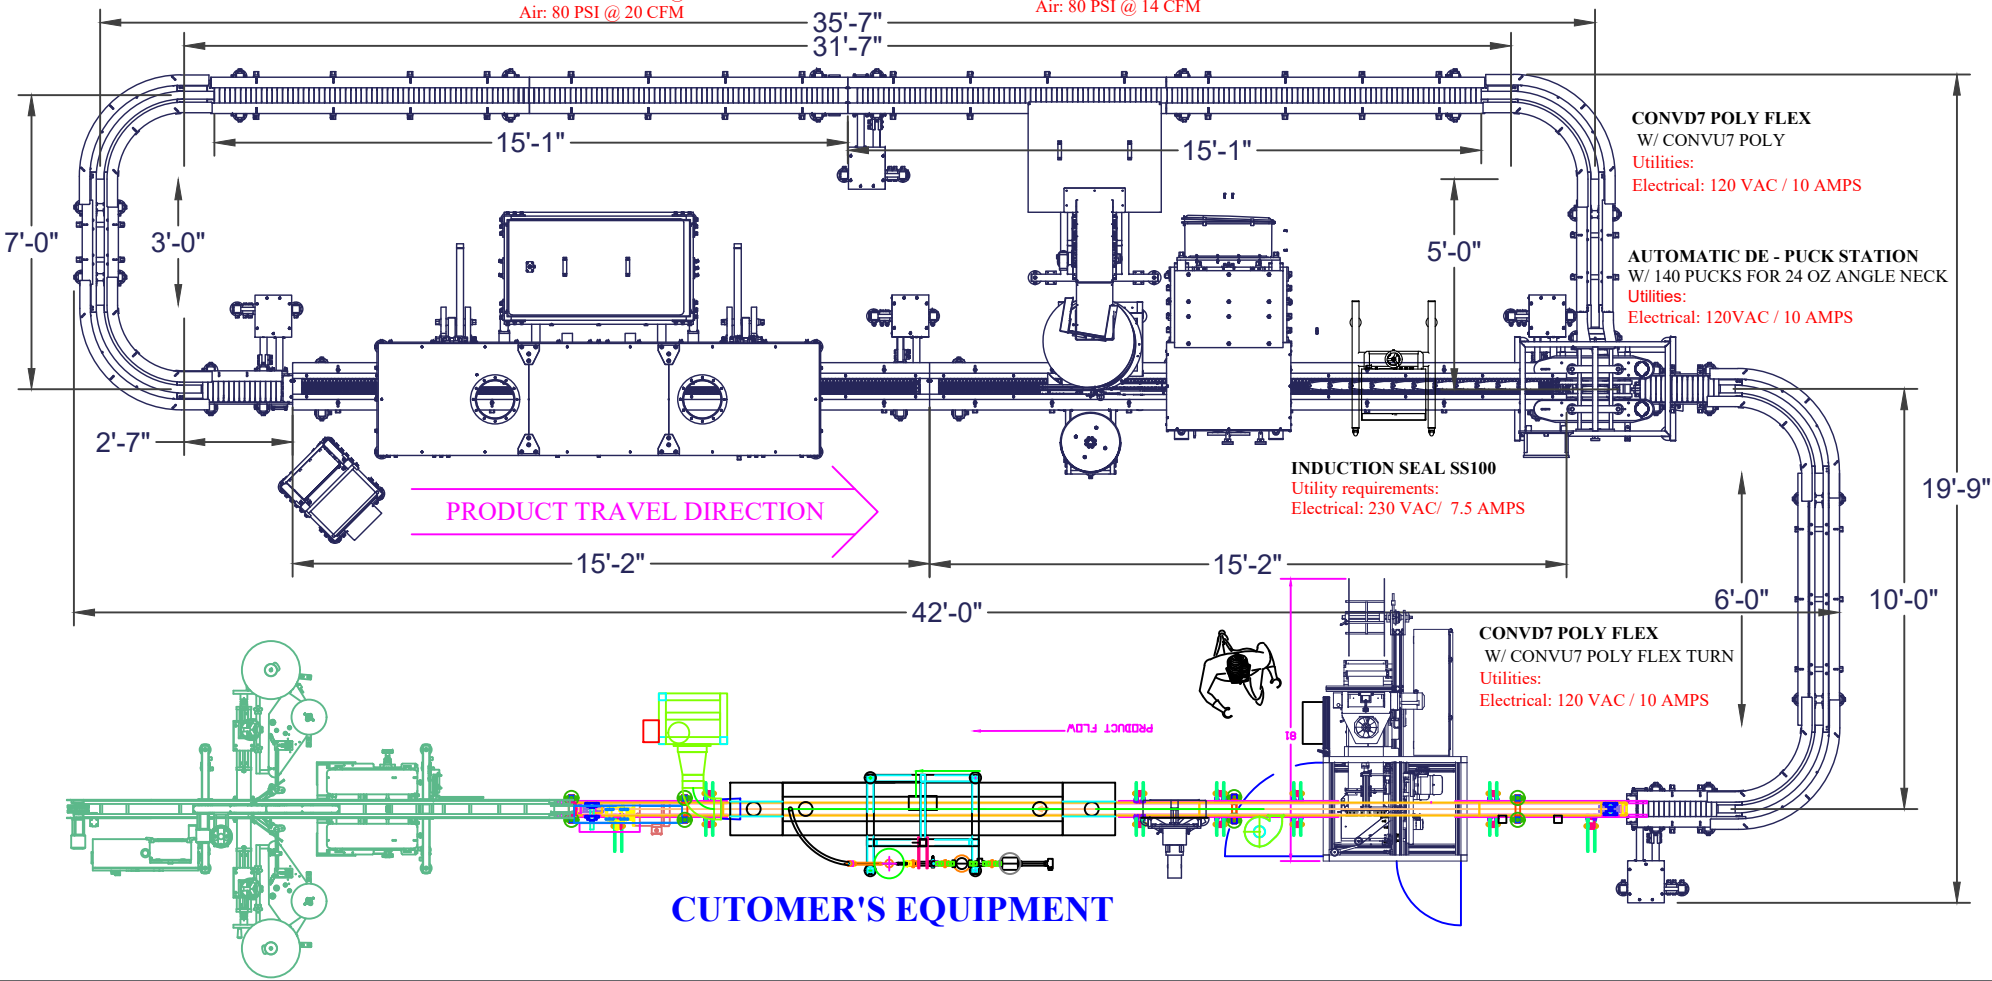

**CUSTOMER'S EQUIPMENT**

DRAWN BY: \_\_\_\_\_ DATE: \_\_\_\_\_ CHECKED BY: \_\_\_\_\_

DOOR DIM : \_\_\_\_\_  
 ROOM DIM : \_\_\_\_\_  
 CEILING HT: \_\_\_\_\_

COMPANY: \_\_\_\_\_

SALES ENGINEER \_\_\_\_\_ CONTACT #: 132323

**INLINE FILLING SYSTEMS**

216 S. SEABOARD AVE. TEL: (941) 486-8800  
 VENICE, FLORIDA 34285 FAX: (941) 486-0077  
 ALL DIMENSIONS ARE IN FEET AND INCHES UNLESS OTHERWISE SPECIFIED.

**APPROVAL DRAWING**

APPROVED  
 APPROVED AS NOTED  
 RESUBMIT

SIGNED \_\_\_\_\_  
 DATE \_\_\_\_\_

SHEET: 1 OF 1